


PLC CONTROL PANEL, CP-01, XXX1, RACK 0 SLOT 8

FIELD / DEVICE

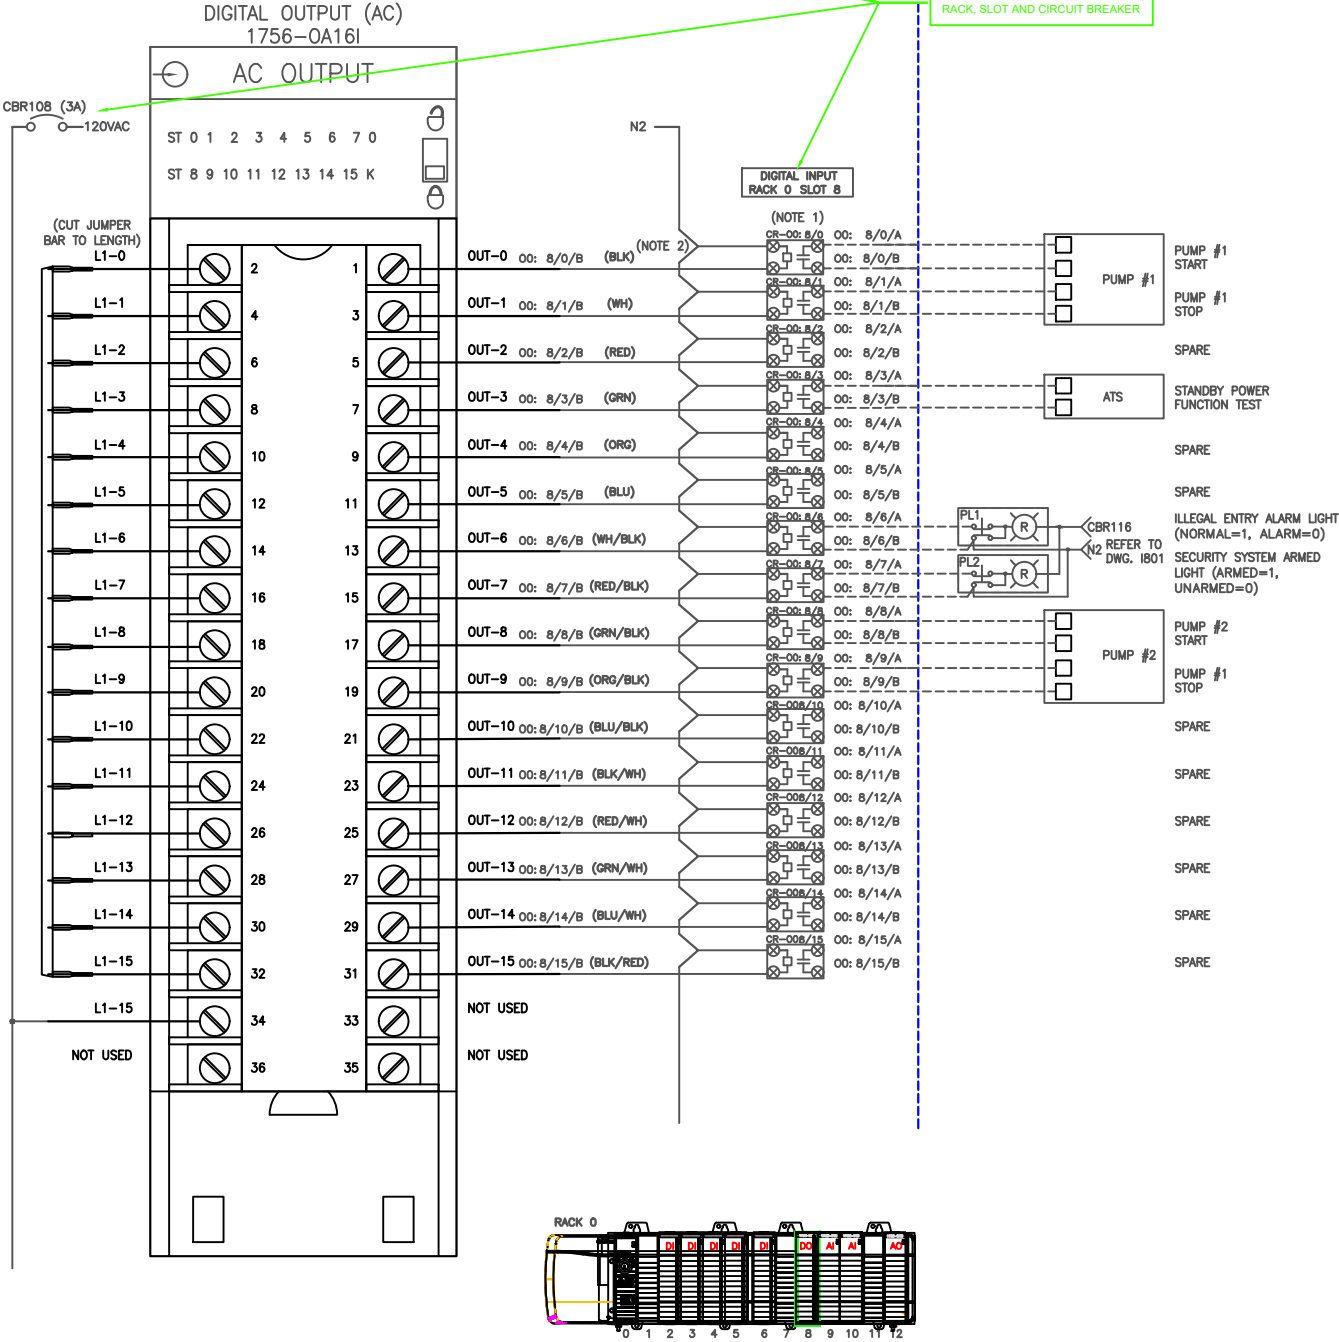

INTENTIONALLY LEFT BLANK

NOTES:

1. EACH CONTROL RELAY LABEL IS TO BE PHYSICALLY LOCATED ON THE CONTROL PANEL BACK PLANE DIRECTLY BESIDE THE RELAY.
2. DIGITAL OUTPUT RELAYS TO BE PLUGGABLE TYPE WITH LED INDICATION.
3. CABLING BETWEEN FUSE AND PLC CARD MUST BE BELDEN PART NUMBER 8619 FOR DIGITAL I/O. BELDEN PART NUMBER 9318 TO BE USED FOR ALL ANALOG I/O FIELD WIRING AND BETWEEN THE TERMINAL BLOCK AND THE PLC CARD.
4. ALL SHIELD TERMINAL BLOCKS TO BE GREEN AND ARE TO BE JUMPED TOGETHER AND TERMINATED TO THE SHIELD GROUNDING BAR.

THESE DRAWINGS ARE TEMPLATE DRAWINGS

1. REMOVE THIS NOTE AS PART OF THE DESIGN PROCESS.
2. MODIFY THIS DRAWING AS DIRECTED IN THE SCADA STANDARDS.
3. ADD ADDITIONAL DETAILS AS REQUIRED TO MEET THE PROJECT SPECIAL REQUIREMENTS.
4. WHEN THE CONSULTANT DEVIATES FROM THIS TEMPLATE THEY ARE REQUIRED TO NOTIFY HALTON REGION THROUGH THE USE OF THE STANDARDS DEVIATION MEMO.
5. FUSED TERMINAL BLOCKS AND CIRCUIT BREAKERS TO BE SIZED APPROPRIATELY.
6. SHOW ADDITIONAL RIO RACKS (UP TO A MAXIMUM OF 2) ONLY IF NECESSARY BASED ON DESIGN REQUIREMENTS.
7. THE CONSULTANT IS TO SPECIFY SIGNAL ISOLATORS WHERE REQUIRED. FOLLOW MANUFACTURERS' SPECIFICATIONS FOR GROUNDING OF SHIELDS.

NO		Date	By	REVISIONS		MAN/CAD
Design	---	---	Ch'kd	---	---	Date
Drawn	---	---	Ch'kd	---	---	References
Scale	N.T.S.					

Field Notes

Stamp

Regional

ACCEPTED FOR CONSTRUCTION OF REGIONAL INFRASTRUCTURE

REVIEWED FOR COMPLIANCE WITH REGIONAL STANDARDS ONLY.

Director, Water & Wastewater Treatment

Manager, Plant Capital & Engineering



TITLE REGIONAL MUNICIPALITY OF HALTON CONSULTANT PROJECT TITLE

SLOT 8  
DO LOOP DIAGRAM

Consultant File NO

Regional Drawing NO

CONTRACT NO

Drawing NO 1807

SHEET XX OF XX

1807\_Slot\_8\_Do\_Loop\_Diagram.dwg

DO NOT REMOVE: HALTON REGION SCADA STANDARDS JANUARY 2022