


ACCESS SWITCH #1
PORT ASSIGNMENT

COPPER ETHERNET
PATCH PANEL #1

WORK AREA OUTLET

DEVICE

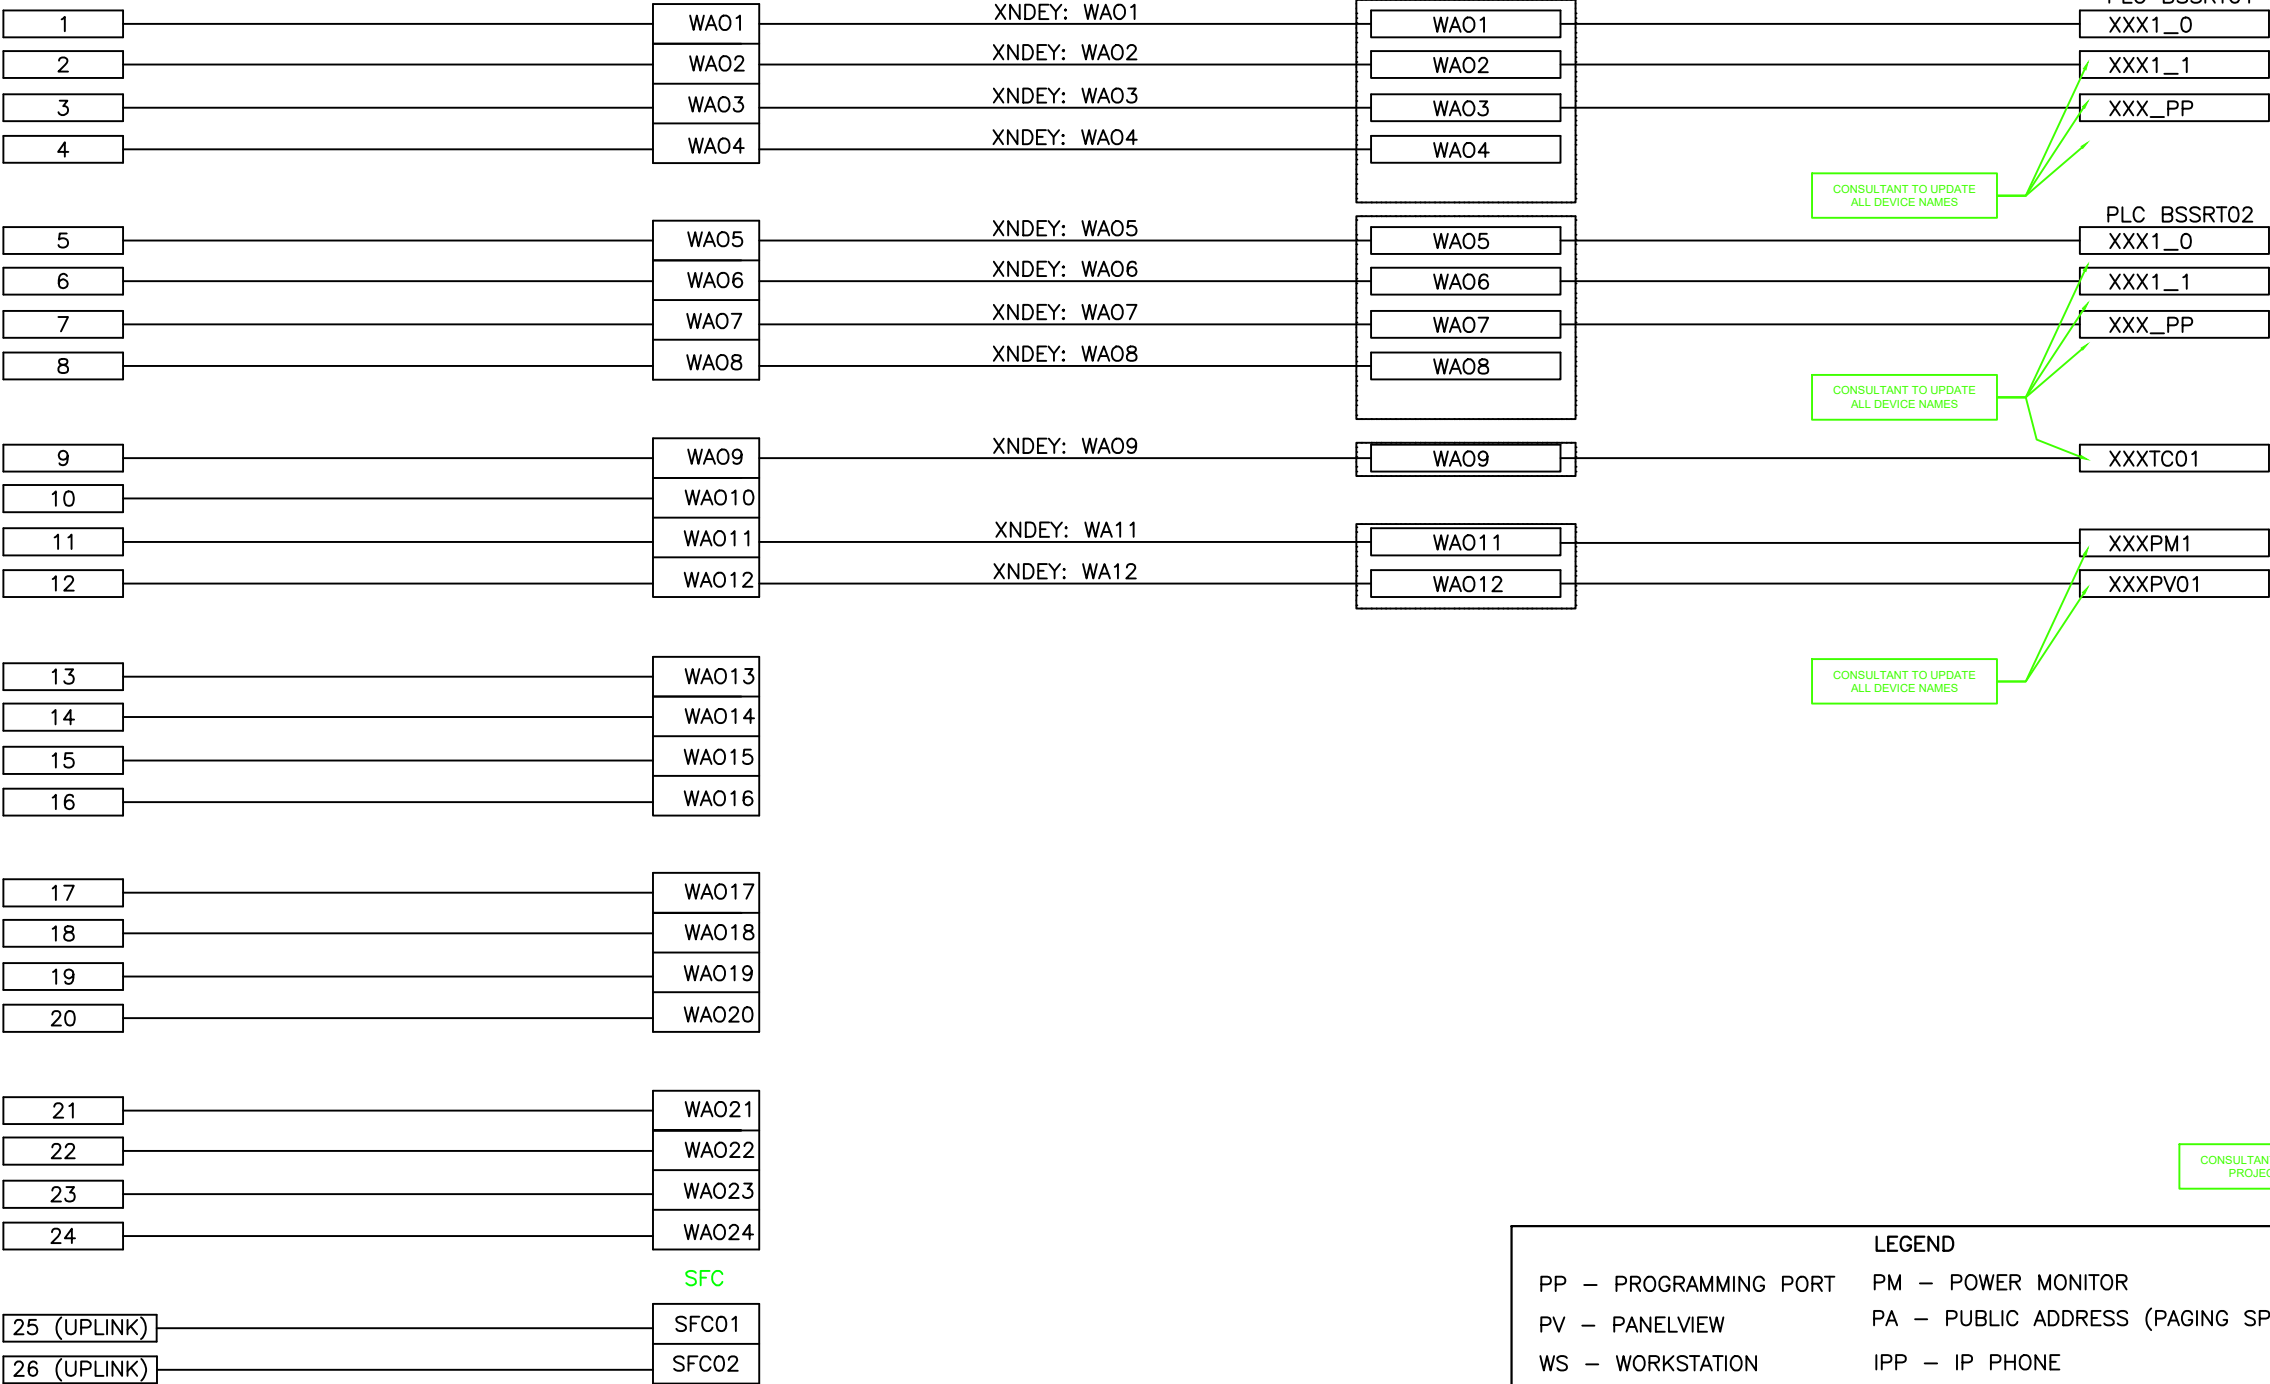

CONSULTANT TO UPDATE
ALL DEVICE NAMES

CONSULTANT TO UPDATE
ALL DEVICE NAMES

CONSULTANT TO UPDATE
ALL DEVICE NAMES

CONSULTANT TO UPDATE
PROJECT TITLE

LEGEND

- PP – PROGRAMMING PORT

PV – PANELVIEW

WS – WORKSTATION

TC – THIN CLIENT
- PM – POWER MONITOR

PA – PUBLIC ADDRESS (PAGING SPEAKER)

IPP – IP PHONE

PLC – PROGRAMMABLE LOGIC CONTROLLER

- NOTES:
1. PATCH CABLES DO NOT REQUIRE LABELS

2. CONTRACTOR TO PROVIDE ALL PATCHCABLES BETWEEN WORK OUTLET AND ALL DEVICES

THESE DRAWINGS ARE TEMPLATE DRAWINGS

1. REMOVE THIS NOTE AS PART OF THE DESIGN PROCESS.

2. MODIFY THIS DRAWING AS DIRECTED IN THE SCADA STANDARDS.

3. ADD ADDITIONAL DETAILS AS REQUIRED TO MEET THE PROJECT SPECIAL REQUIREMENTS.

4. WHEN THE CONSULTANT DEVIATES FROM THIS TEMPLATE THEY ARE REQUIRED TO NOTIFY HALTON REGION THROUGH THE USE OF THE STANDARDS DEVIATION MEMO.

NO	Date	By	REVISIONS	MANU	CAD
Design	---	Ch'kd	---	Date	
Drawn	---	Ch'kd	---		
Scale	N.T.S.		References		

Field Notes

Stamp

Regional

ACCEPTED FOR CONSTRUCTION
OF REGIONAL INFRASTRUCTURE

REVIEWED FOR COMPLIANCE WITH
REGIONAL STANDARDS ONLY.

Director, Water & Wastewater Treatment

Manager, Plant Capital & Engineering



TITLE REGIONAL MUNICIPALITY OF HALTON
CONSULTANT PROJECT TITLE

CAT6
PORT ASSIGNMENT

Consultant File NO	Regional Drawing NO
CONTRACT NO	Drawing NO C420
	SHEET XX OFXX