




DIGESTER AREA – MULTI MODE FIBRE

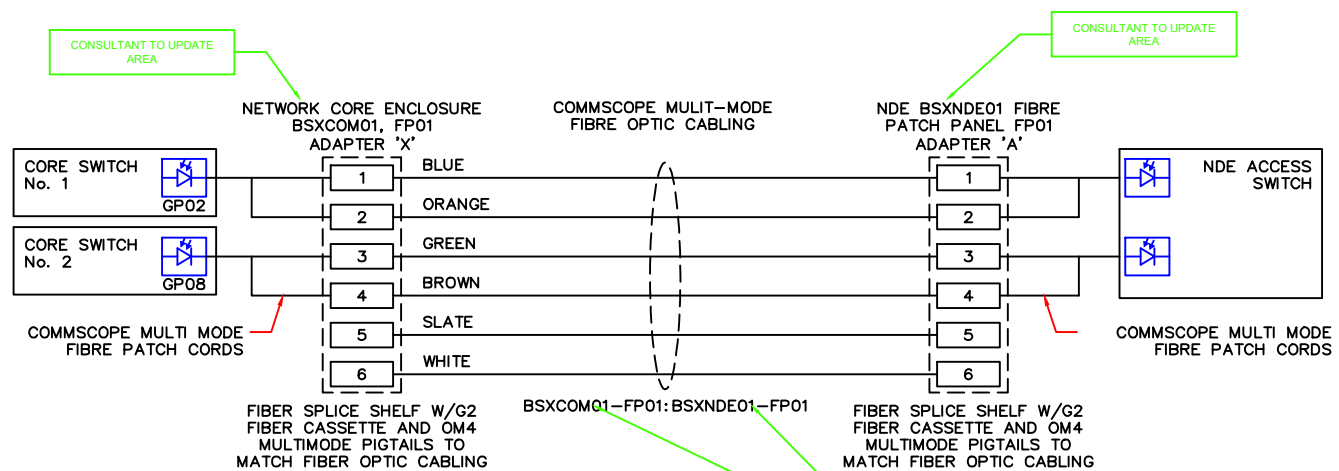

LOW LIFT PUMPS – MULTI MODE FIBRE

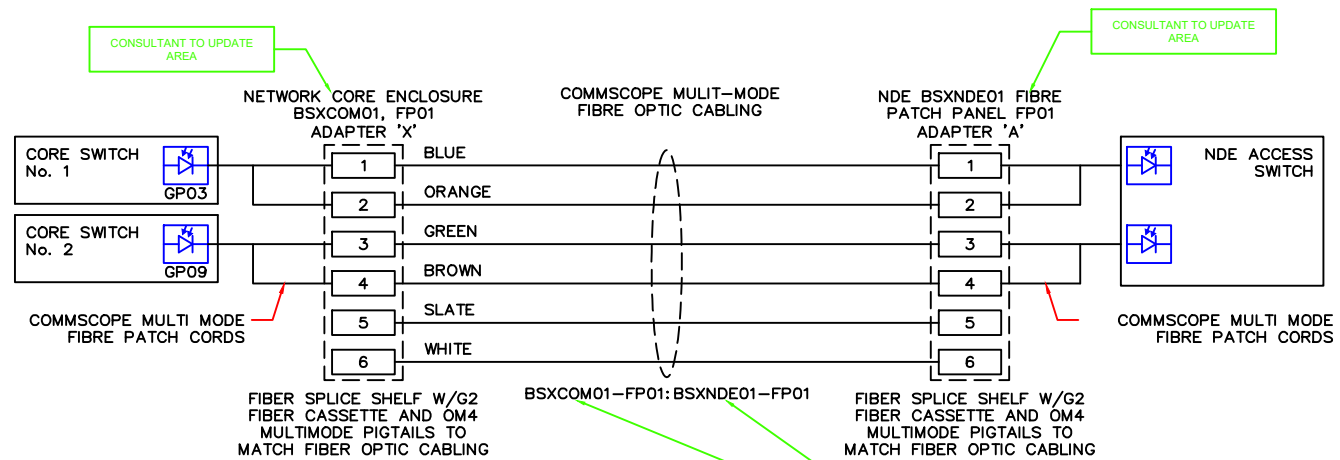

PRIMARY CLARIFIER AREA – MULTI MODE FIBRE

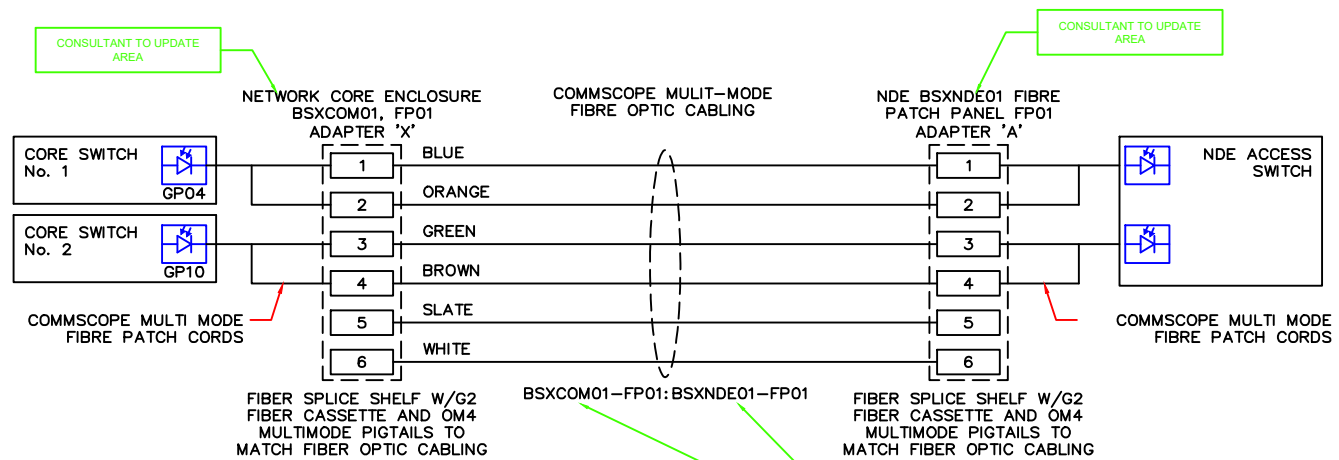

ACTIFLO AREA – MULTI MODE FIBRE

NOTES:

1. FIBRE OPTIC CABLES ARE TO BE LABELED AT BOTH ENDS AND AT EACH TRANSITION. A TRANSITION DEFINED AS A CHANGE IN DUCTING. ALL DUCTING CARRYING FIBRE OPTIC CABLE IS TO BE TAGGED AS 'LAN BACKBONE'.

THESE DRAWINGS ARE TEMPLATE DRAWINGS

1. REMOVE THIS NOTE AS PART OF THE DESIGN PROCESS.

2. MODIFY THIS DRAWING AS DIRECTED IN THE SCADA STANDARDS.

3. ADD ADDITIONAL DETAILS AS REQUIRED TO MEET THE PROJECT SPECIAL REQUIREMENTS.

4. WHEN THE CONSULTANT DEVIATES FROM THIS TEMPLATE THEY ARE REQUIRED TO NOTIFY HALTON REGION THROUGH THE USE OF THE STANDARDS DEVIATION MEMO.

5. FUSED TERMINAL BLOCKS AND CIRCUIT BREAKERS TO BE SIZED APPROPRIATELY.

6. SHOW ADDITIONAL TWO THICKS (UP TO A MAXIMUM OF 2) ONLY IF NECESSARY BASED ON DESIGN REQUIREMENTS.

7. THE CONSULTANT IS TO SPECIFY SIGNAL ISOLATORS WHERE REQUIRED. FOLLOW MANUFACTURERS' SPECIFICATIONS FOR GROUNDING OF SHELDS.

NO	Date	By	REVISIONS	MAN/CAD
Design	---	Ch'kd	---	Date
Drawn	---	Ch'kd	---	
Scale	N.T.S.			References

Field Notes

Stamp

Regional

ACCEPTED FOR CONSTRUCTION OF REGIONAL INFRASTRUCTURE

REVIEWED FOR COMPLIANCE WITH REGIONAL STANDARDS ONLY.

Director, Water & Wastewater Treatment

Manager, Plant Capital & Engineering

TITLE REGIONAL MUNICIPALITY OF HALTON
CONSULTANT PROJECT TITLE

MULTI MODE FIBRE
PANEL PORT ASSIGNMENT

Consultant File NO	Regional Drawing NO
---	---
CONTRACT NO	Drawing NO
---	C418
	SHEET XX OF XX