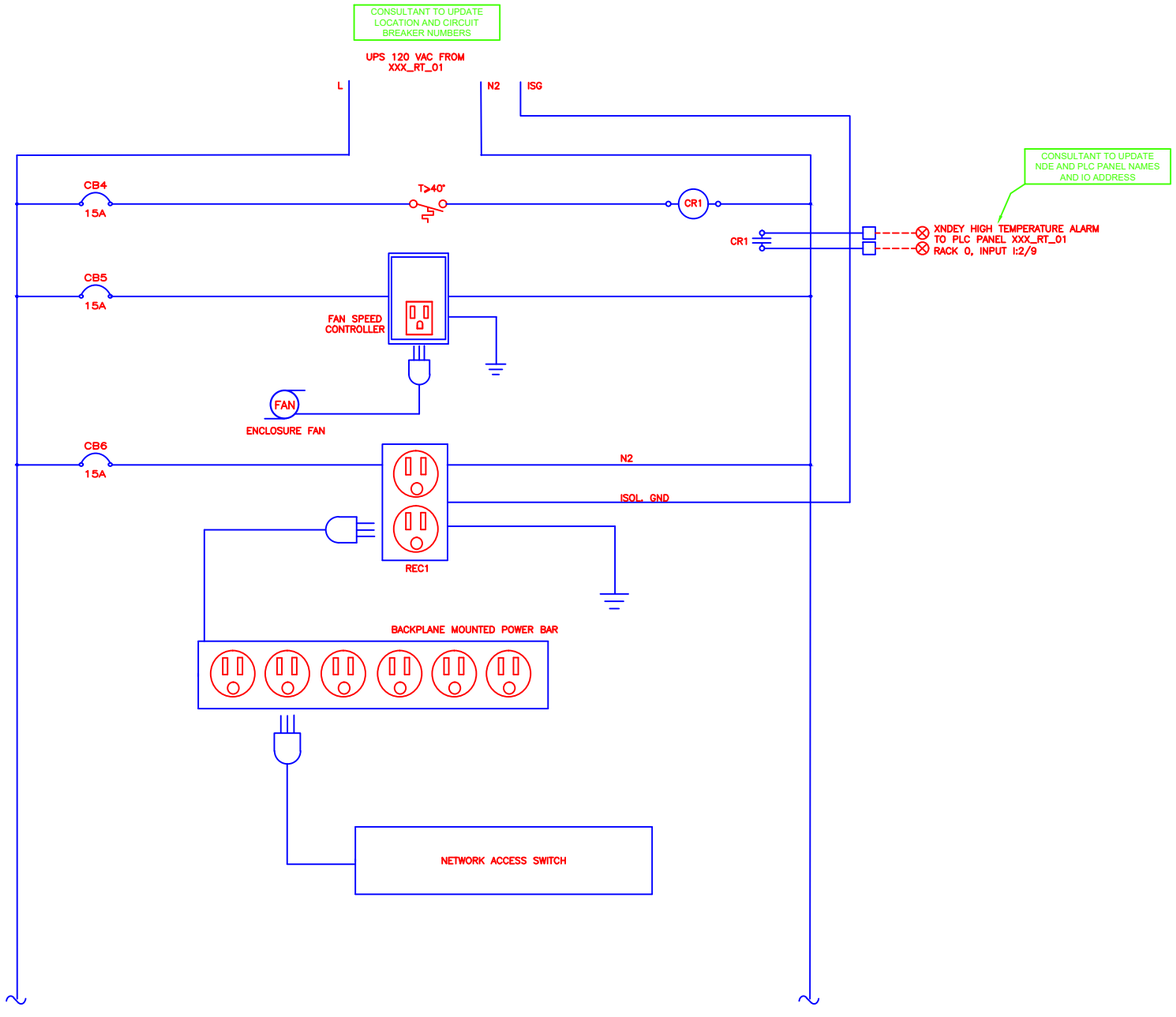

DO NOT REMOVE: HALTON REGION SCADA STANDARDS JANUARY 2022

NOTES:

THESE DRAWINGS ARE TEMPLATE DRAWINGS

1. REMOVE THIS NOTE AS PART OF THE DESIGN PROCESS.
2. MODIFY THIS DRAWING AS DIRECTED IN THE SCADA STANDARDS.
3. ADD ADDITIONAL DETAILS AS REQUIRED TO MEET THE PROJECT SPECIAL REQUIREMENTS.
4. WHEN THE CONSULTANT DEVIATES FROM THIS TEMPLATE THEY ARE REQUIRED TO NOTIFY HALTON REGION THROUGH THE USE OF THE STANDARDS DEVIATION MEMO.
5. FUSED TERMINAL BLOCKS AND CIRCUIT BREAKERS TO BE SIZED APPROPRIATELY.
6. THE CONSULTANT IS TO SPECIFY SIGNAL ISOLATORS WHERE REQUIRED. FOLLOW MANUFACTURERS' SPECIFICATIONS FOR GROUNDING OF SHIELDS.

NO	Date	By	REVISIONS	MANU	CAD

Design	---	Ch'kd	---	Date
Drawn	---	Ch'kd	---	
Scale	N.T.S.			References

Field Notes

Stamp

Regional

ACCEPTED FOR CONSTRUCTION OF REGIONAL INFRASTRUCTURE

REVIEWED FOR COMPLIANCE WITH REGIONAL STANDARDS ONLY.

Director, Water & Wastewater Treatment

Manager, Plant Capital & Engineering

UPDATE NAME FOR THE SPECIFIC NDE

CONSULTANT TO UPDATE PROJECT TITLE

TITLE

REGIONAL MUNICIPALITY OF HALTON
CONSULTANT PROJECT TITLE

REMOTE SITE
NETWORK DISTRIBUTION ENCLOSURE
POWER DISTRIBUTION

Consultant File NO ---	Regional Drawing NO ---
CONTRACT NO ---	Drawing NO R418
	SHEET XX OFXX

R418_Remote_Site_NDE_Power_Distribution.dwg