


STILLING WELL INSTALLATION DETAIL
NTS

1


EXXX

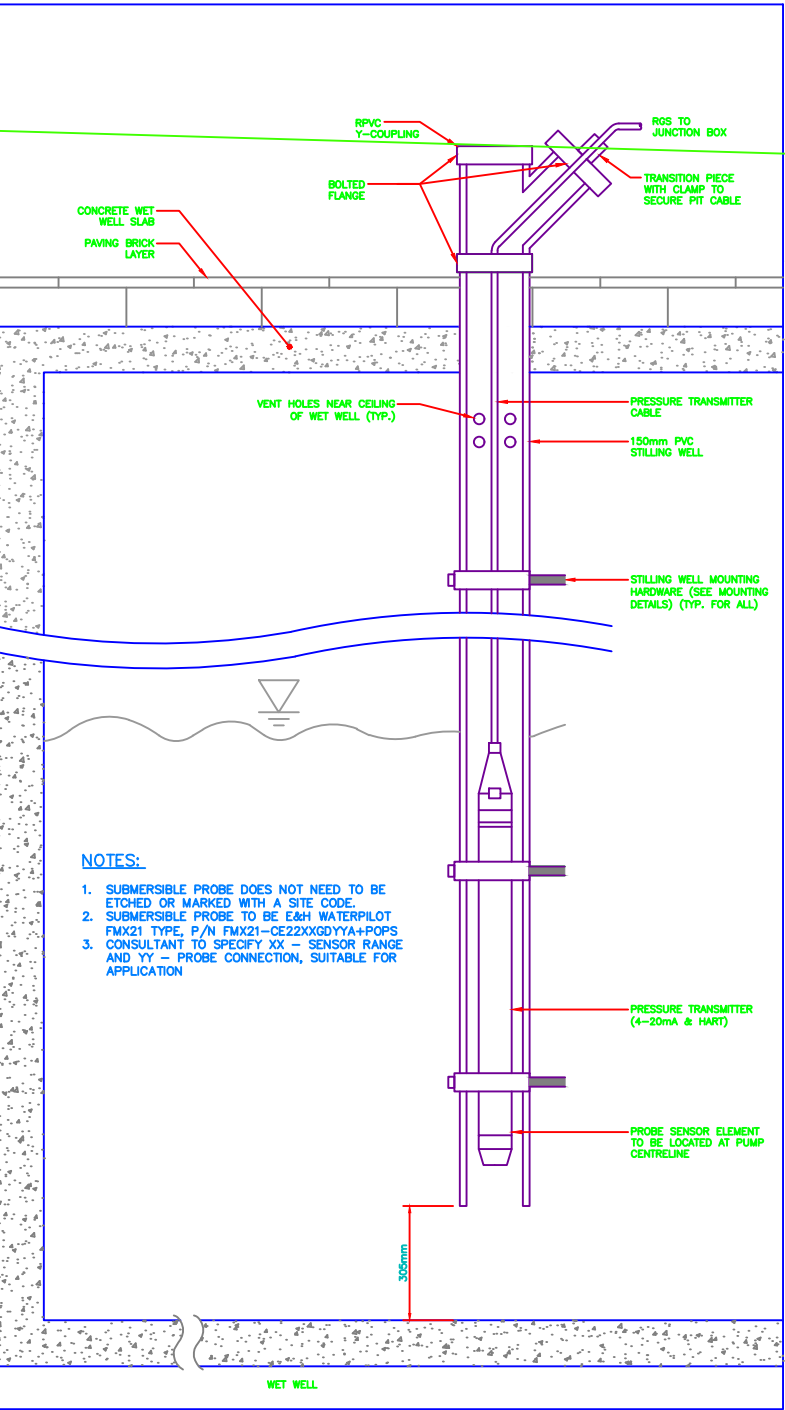

STILLING WELL INSTALLATION DETAIL
NTS

2

EXXX

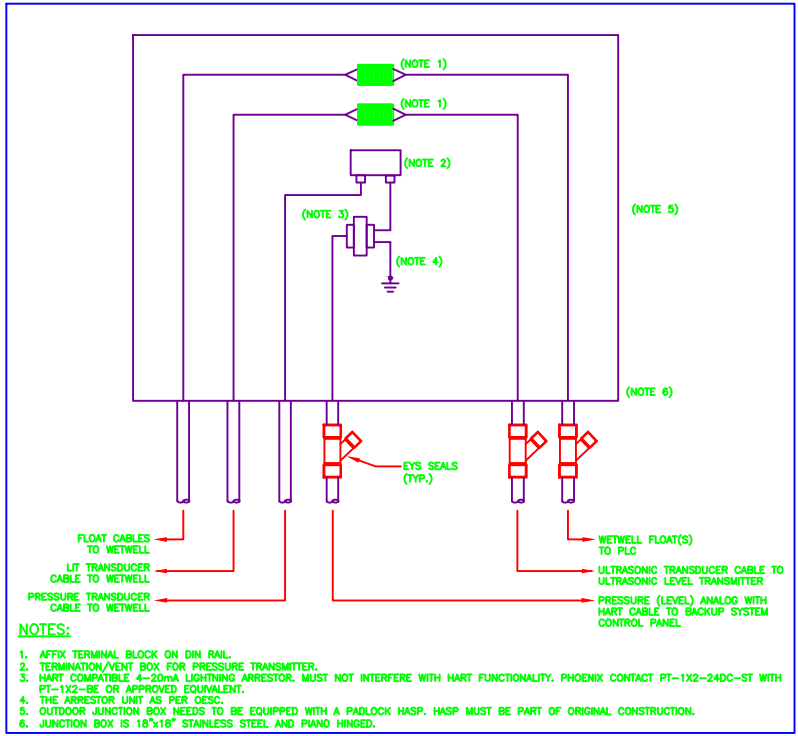

INSTRUMENTATION JUNCTION BOX (NEMA 4X)
NTS

3

EXXX

NOTES:

- THESE DRAWINGS ARE TEMPLATE DRAWINGS
1. REMOVE THIS NOTE AS PART OF THE DESIGN PROCESS.
 2. MODIFY THIS DRAWING AS DIRECTED IN THE SCADA STANDARDS.
 3. ADD ADDITIONAL DETAILS AS REQUIRED TO MEET THE PROJECT SPECIAL REQUIREMENTS.
 4. WHEN THE CONSULTANT DEVIATES FROM THIS TEMPLATE THEY ARE REQUIRED TO NOTIFY HALTON REGION THROUGH THE USE OF THE STANDARDS DEVIATION MEMO.
 5. FUSED TERMINAL BLOCKS AND CIRCUIT BREAKERS TO BE SIZED APPROPRIATELY.
 6. SHOW ADDITIONAL RIO RACKS (UP TO A MAXIMUM OF 2) ONLY IF NECESSARY BASED ON DESIGN REQUIREMENTS.
 7. THE CONSULTANT IS TO SPECIFY SIGNAL ISOLATORS WHERE REQUIRED. FOLLOW MANUFACTURERS' SPECIFICATIONS FOR GROUNDING OF SHIELDS.

NO				Date		By		REVISIONS		MANU CAD	
Design		---		Ch'kd		---		Date			
Drawn		---		Ch'kd		---					
Scale		N.T.S.						References			

Field Notes

Stamp

Regional
ACCEPTED FOR CONSTRUCTION
OF REGIONAL INFRASTRUCTURE

REVIEWED FOR COMPLIANCE WITH
REGIONAL STANDARDS ONLY.

Director, Water & Wastewater Treatment

Manager, Plant Capital & Engineering



TITLE REGIONAL MUNICIPALITY OF HALTON
CONSULTANT PROJECT TITLE

STILLING WELL
LEVEL PROBE INSTALLATION

Consultant File NO

Regional Drawing NO

CONTRACT NO

Drawing NO E805

SHEET XX OF XX